

RCD Instructions

Installation Instruction

This product **MUST** be installed by a licensed electrician.

Line and Load can be top or bottom.


To avoid damage to RCD, disconnect before insulation testing.

Connect the Neutral cable for the circuit before connecting the Line active cable.


Applications:

- Used in domestic installations as well as commercial electrical distribution systems.
- Protection for persons and equipment.

Wiring




Status Indication

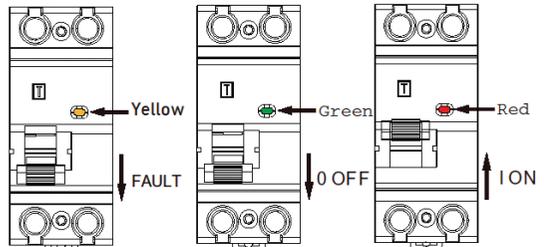


Green-RCD turned off.
Yellow-RCD tripped from fault or test button.
RED-RCD is on.

Mounting

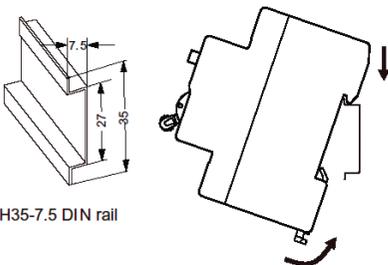

TH35-7.5 DIN rail

Dismounting

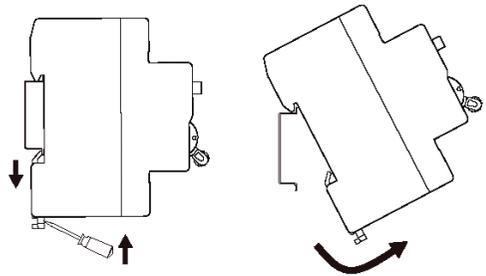

WARNING: If RCD trips, it may be caused by earth leakage. The installation should be checked before resetting RCD.